Stokers

DIAGRAM SYMBOL LEGEND	
DISPLAY	DESCRIPTION
—#—	POWER WIRE
———	CONTROL WIRE
— —	REF. PIPE

CONT.No	KA2624	PAGE	1 / 1

CITY MULTI

SYSTEM SCHEMATIC DWG.

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.

PIPING LIST	
SYMBOL	BRANCH PIPE MODEL NAME
J1	CMY-Y202-G
J2	CMY-Y102L-G
J3	CMY-Y102S-G

SYMBOL	LIQUID PIPE/GAS PIPE SIZE
P1	1/2"OD/1 1/8"OD
P2	3/8"OD/7/8"OD
P3	3/8"OD/3/4"OD
P4	3/8"OD/5/8"OD
P5	1/4"OD/1/2"OD

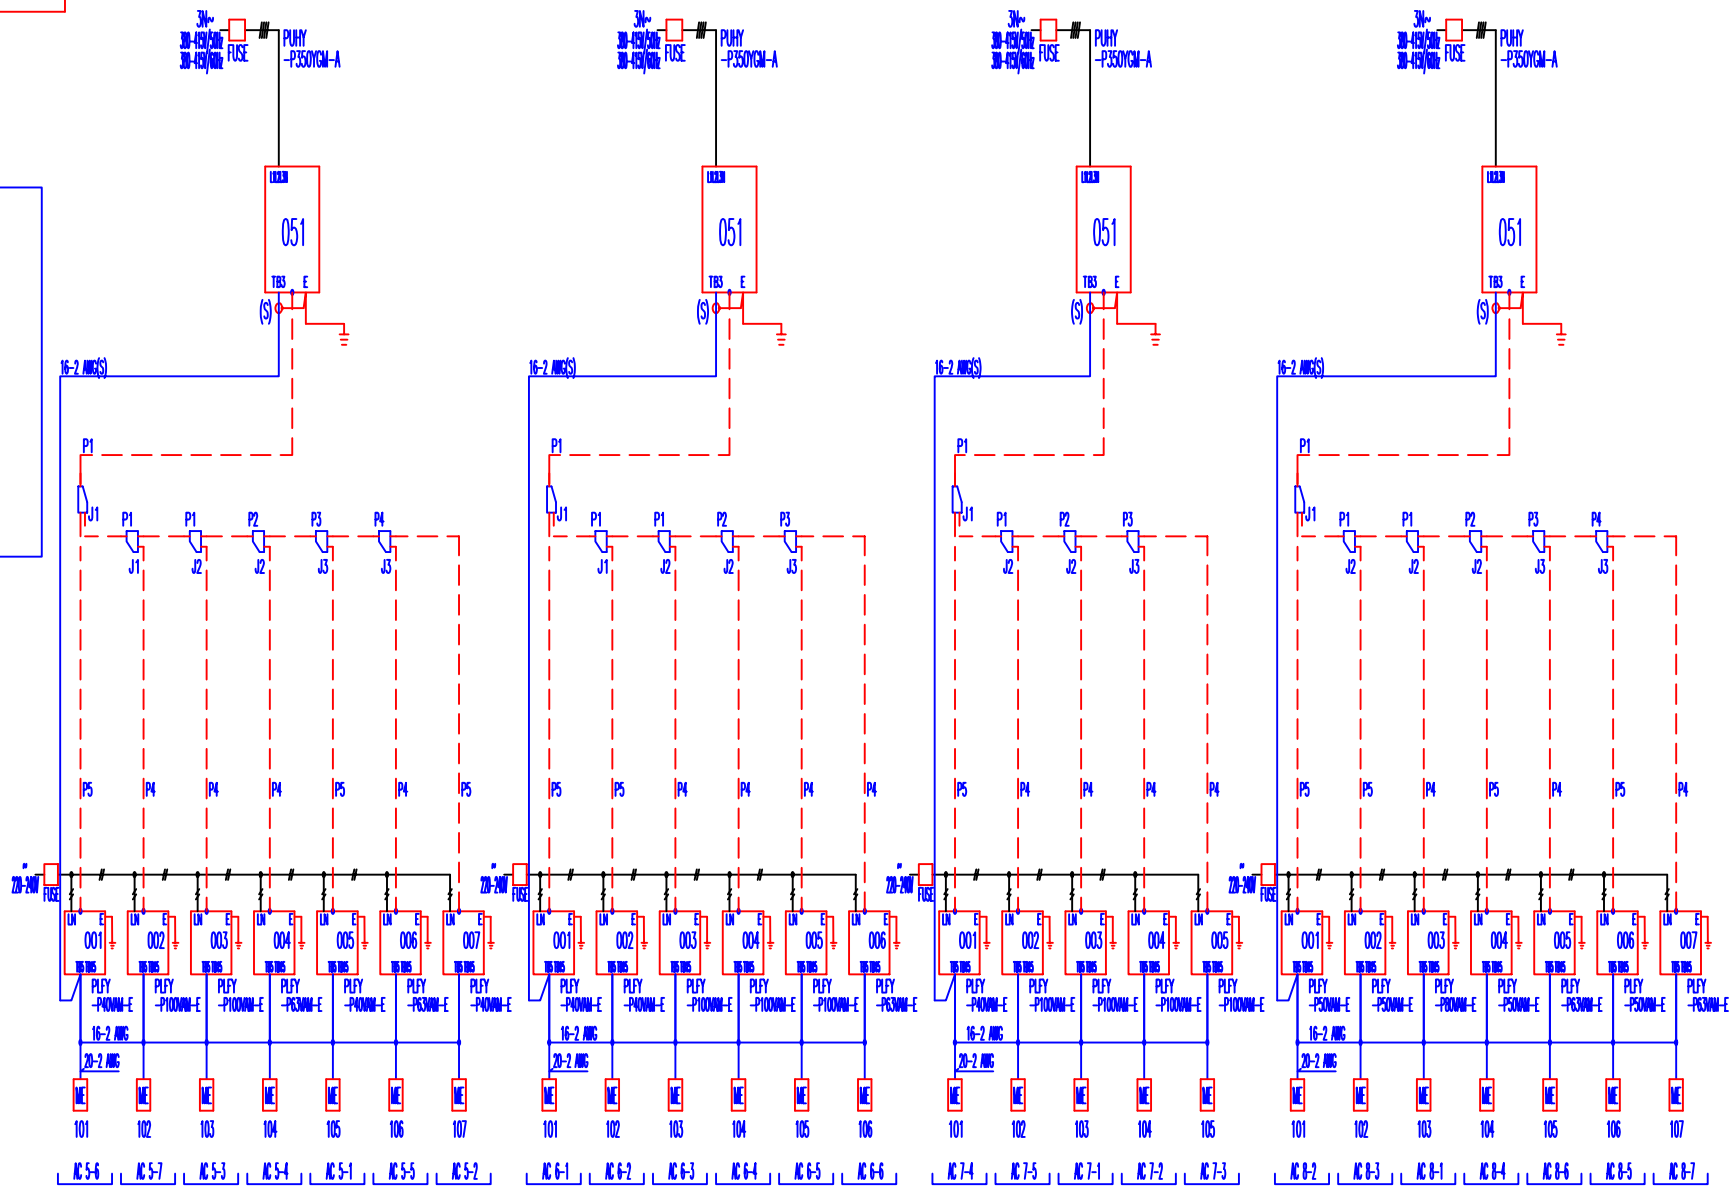

REMARKS

First Floor
1.25mm²(16 AWG) : 1.25mm²(16 AWG) or more.
0.75mm²(20 AWG) : between 0.5mm²(24 AWG) and 0.75mm²(20 AWG).

Kelvinair Ltd 0113 2435199
Approved Mitsubishi Installer

PREPARED ON 14/06/2007