

Stokers


DIAGRAM	SYMBOL	LEGEND
DISPLAY	—#—	POWER WIRE
	—	CONTROL WIRE
	—	REF. PIPE

CONTINO KA2624 PAGE 1/1

CITY MULTI  
SYSTEM SCHEMATIC DWG.

Additional refrigerant charge is needed depending on the size and length of extended piping.  
Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.

PIPING LIST	
SYMBOL	REF. MODEL NAME
J1	CMV-Y102-G
J2	CMV-Y102L-G
J3	CMV-Y102S-G
J4	Reducer
SYMBOL LOAD PRE. CHG. PRE. SIZE	
P1	1/2"Ø
P2	3/8"Ø
P3	3/8"Ø
P4	3/8"Ø
P5	1/2"Ø
P6	3/4"Ø

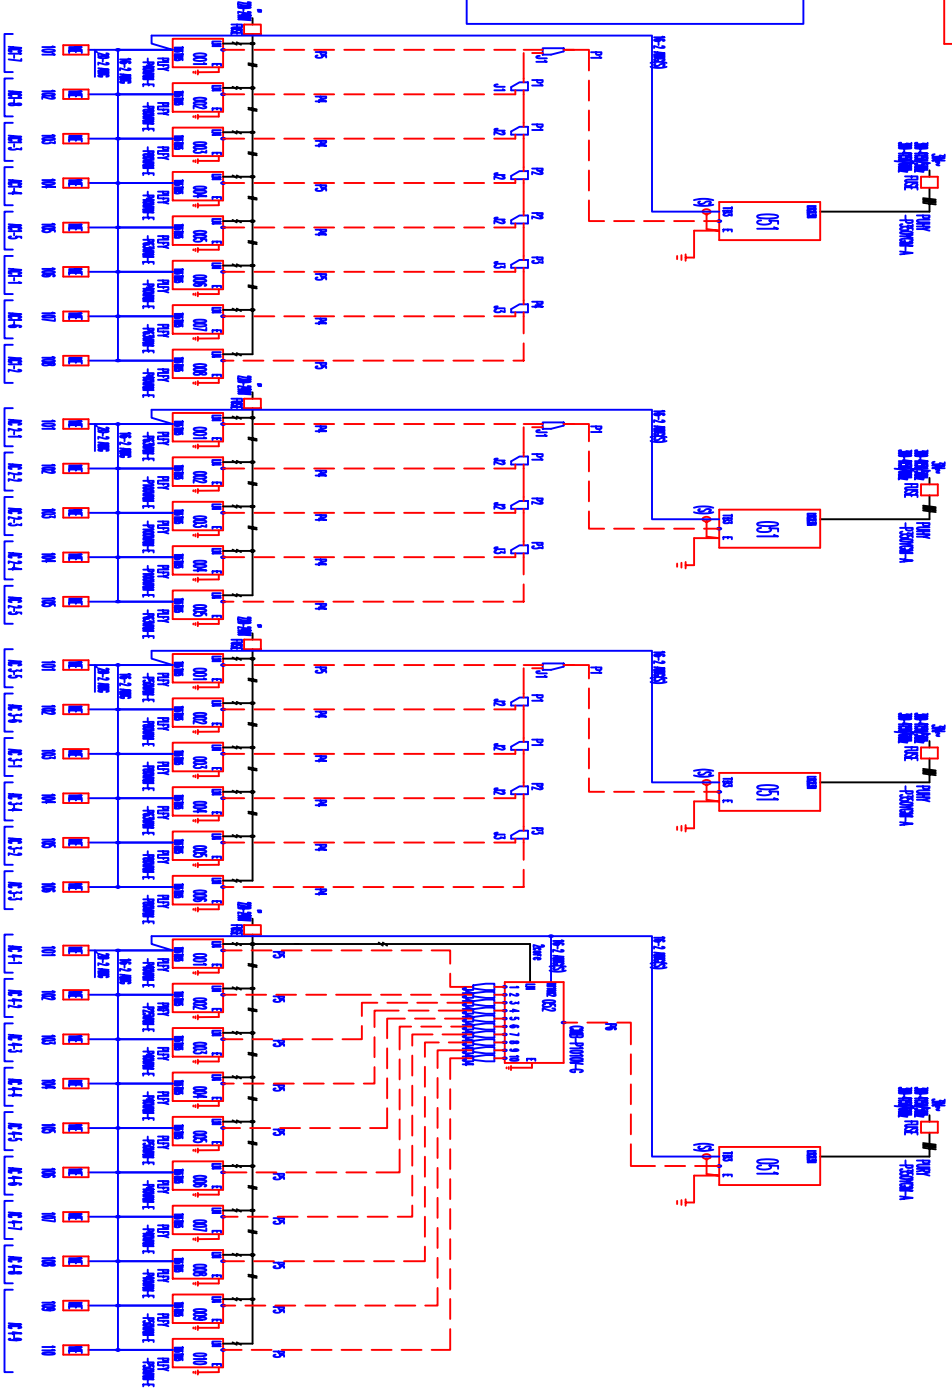

REMARKS  
Ground Floor  
1.25mm<sup>2</sup>(16 AWG) : 1.25mm<sup>2</sup>(16 AWG) or more.  
0.75mm<sup>2</sup>(20 AWG) : between 0.5mm<sup>2</sup>(24 AWG) and 0.75mm<sup>2</sup>(20 AWG).

Kelvinair Ltd 0113 2435199  
Approved Mitsubishi Installer  
PREPARED ON 14/06/2007